


NOTES

MAIN BKR MUST BE LOCATED OUSIDE
PER NEC 230.70

SURGE PROTECTION DEVICE REQUIRED
PER NEC 230:67

FEEDER PER NEC TABLE 310.12(A)

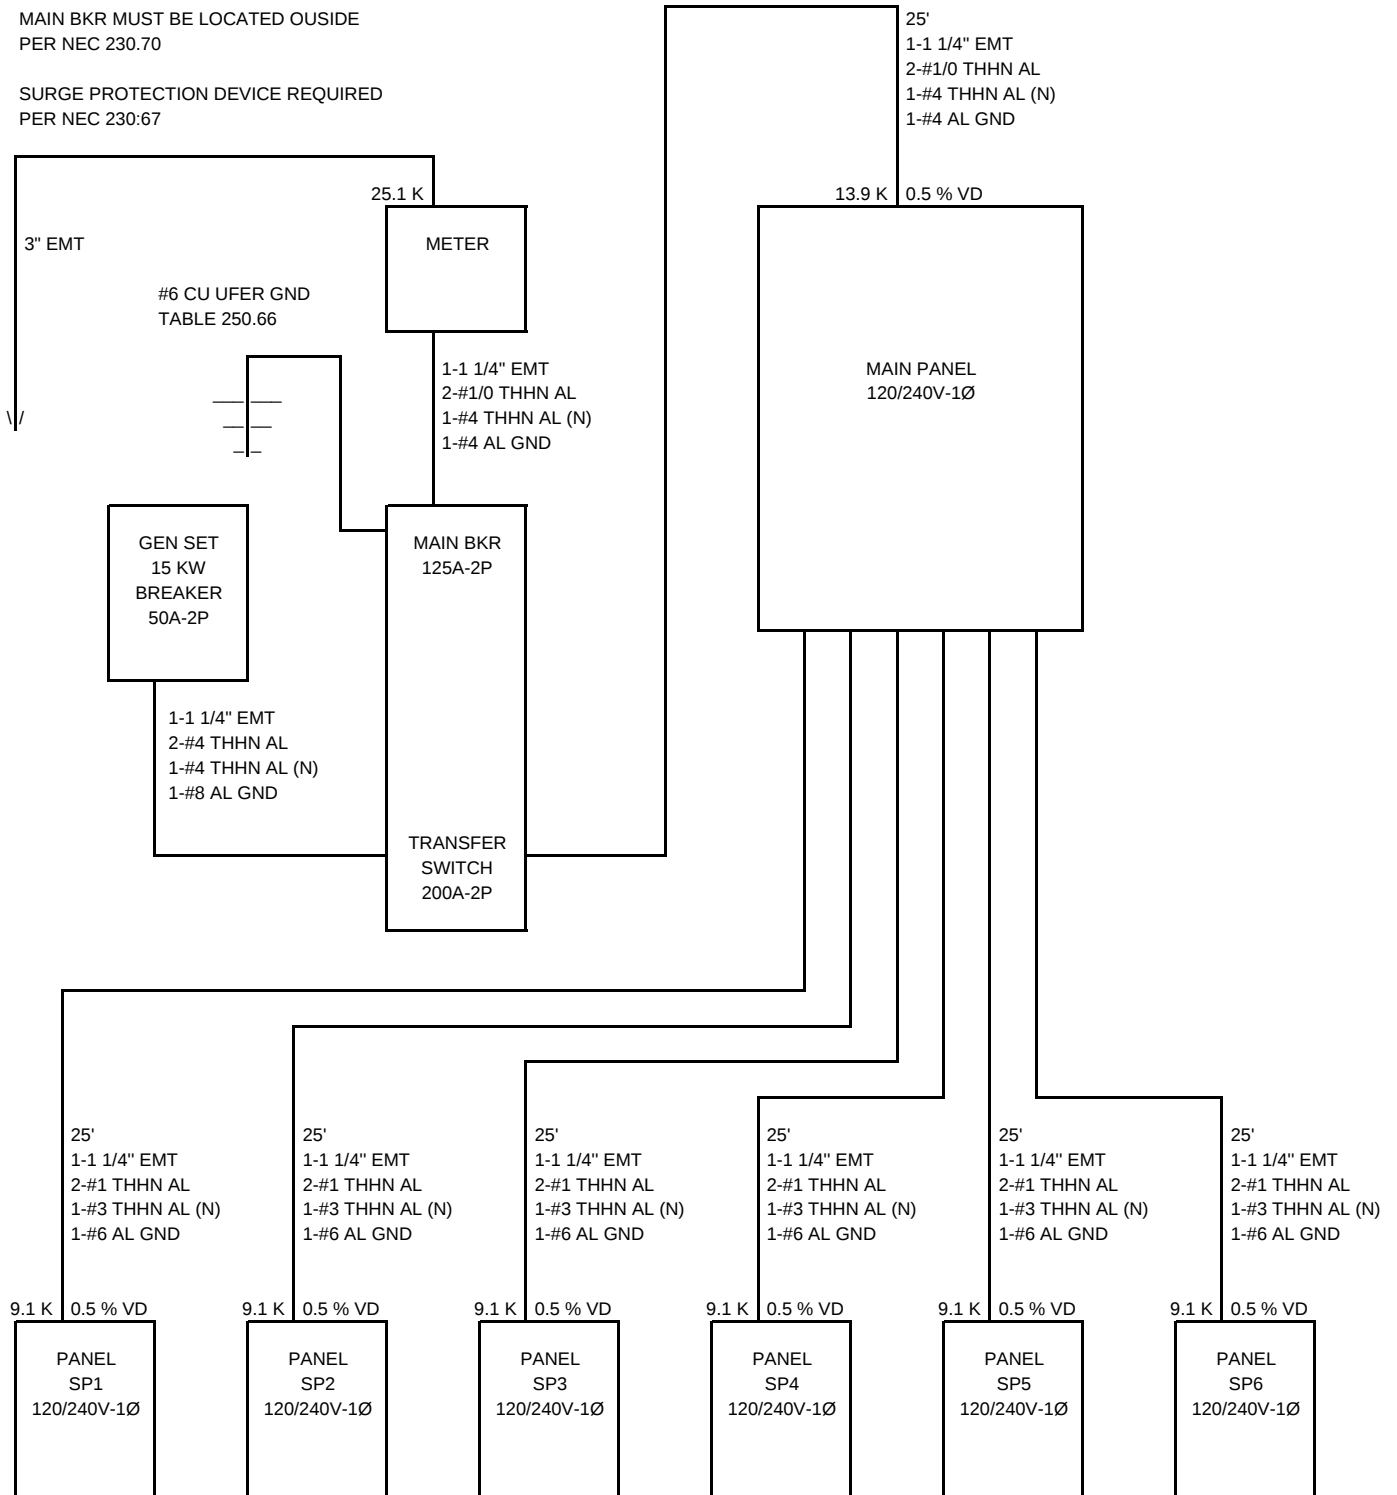

SP1 - FEEDER PER NEC TABLE 310-16 75° C
SP2 - FEEDER PER NEC TABLE 310-16 75° C
SP3 - FEEDER PER NEC TABLE 310-16 75° C
SP4 - FEEDER PER NEC TABLE 310-16 75° C
SP5 - FEEDER PER NEC TABLE 310-16 75° C
SP6 - FEEDER PER NEC TABLE 310-16 75° C

1-LINE DRAWING

SAMPLE
123 MAIN
FOLSOM, CA 95630